



1 IMMIX Master and Remote Station Link Wiring

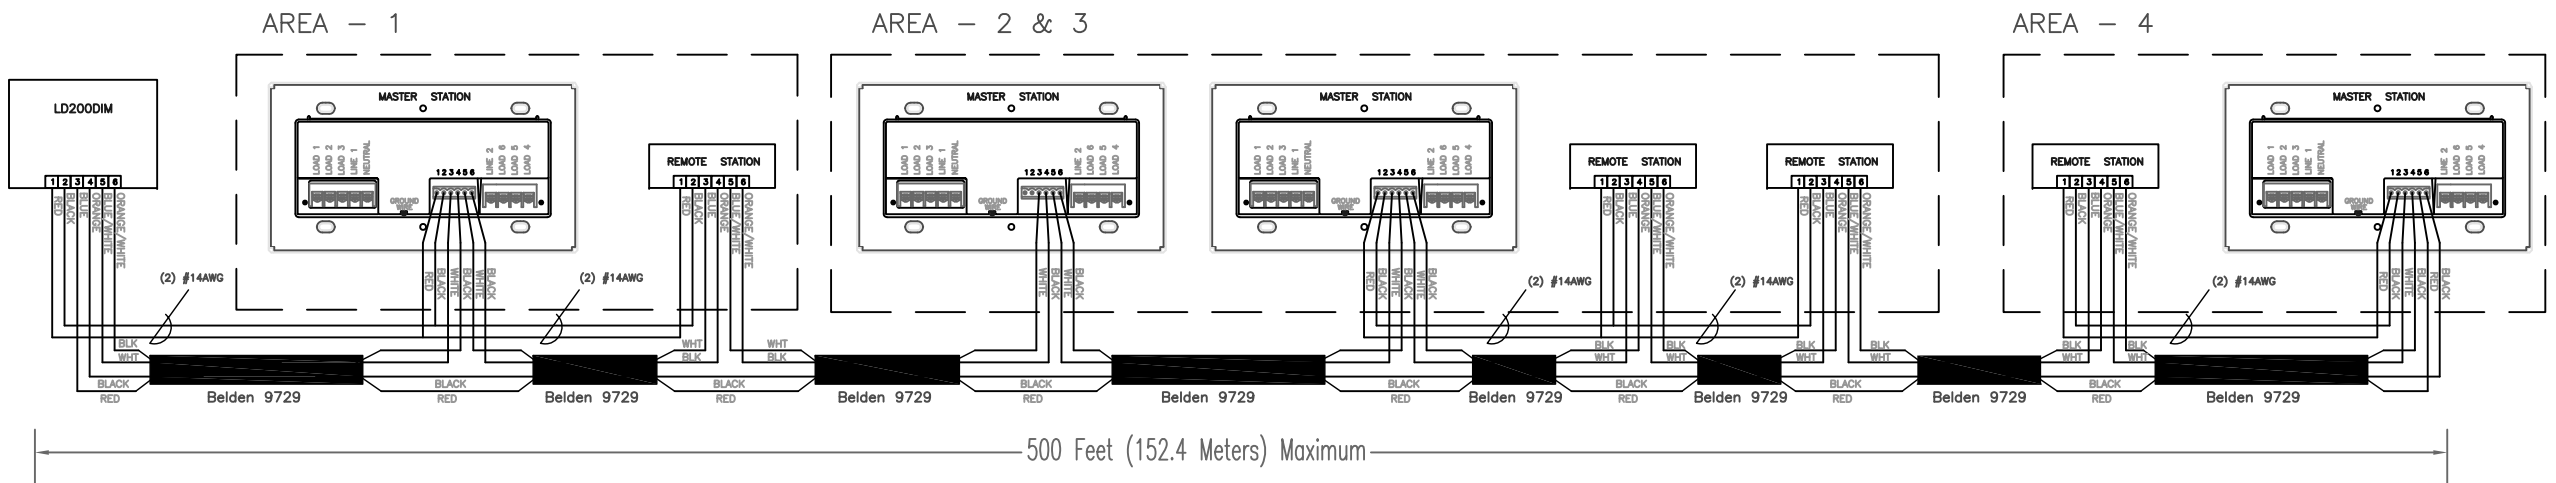


NOTES:

1. The IMMIX network requires Belden #9729 (2 shielded pair) plus 2 #14 AWG wires for low voltage power.
2. Station Link communication maximum distance from LD200DIM to farthest Station is 500 feet (152.4 Meters).
3. Belden cable and 14 AWG wires must be properly marked with the location of origin.


2 LD200DIM Communication Wiring

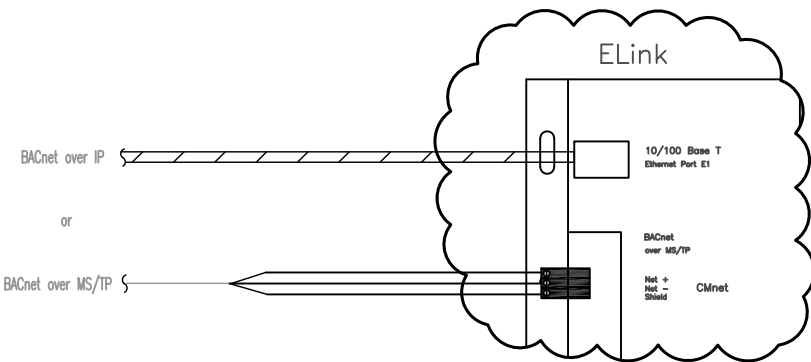

3 Remote Station Detail

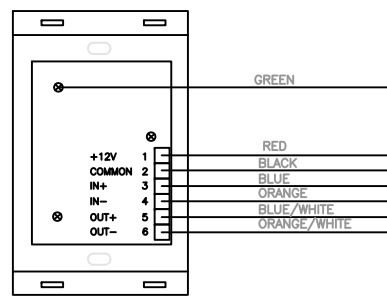

4 Master Station Detail

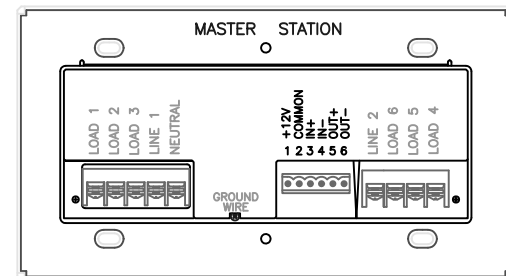

1800 Sandy Plains Ind. Pkwy., Suite 216
 Marietta, Georgia 30066
 Ph: 770-790-4880 Fax: 770-790-4883
<http://www.BRTINT.com>

Product: IMMIX NETWORK DETAIL

Engineered by: CCJ
 Drawn by: CCJ
 Checked by: RP

Date: 06/02/2010

Rev.	Date	By	Description

Sheet
 IMMIX_ND